
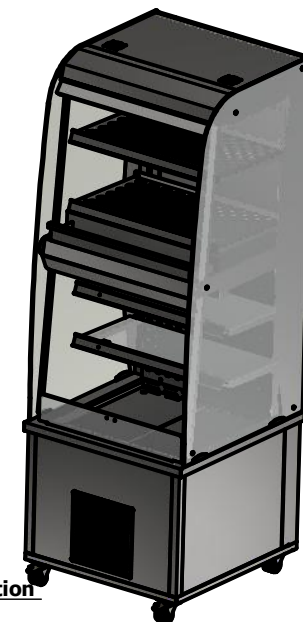
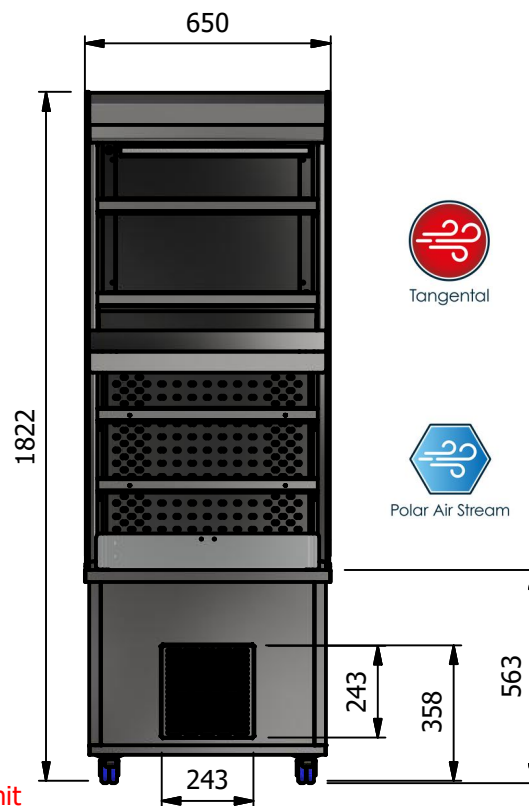


Allowances must be made for air venting.
The under slung compressor must have an unrestricted air flow.
Vents must not be blocked, cool air from the room is drawn in through the front condensing coil and out the rear

Do not install unit in draughty conditions where the air movement is greater than 0.2mtr/sec.
e.g.near entrance/exit doors, open windows, under air conditioning units or a ceiling mounted fan
Do not install units where there is high radiated heat, e.g. direct sunlight, room heaters, or bright spot lights.
Ambient room conditions must not exceed 25°C or a relative humidity of 60%.
Blocked vents will cause reduced refrigeration efficiency and lead to malfunction

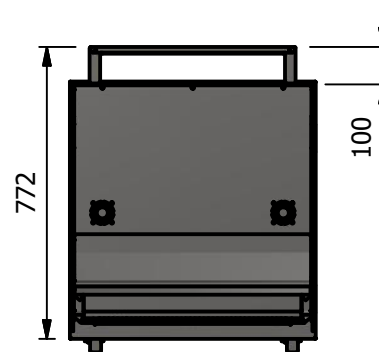

Width - 650mm
Depth - 680mm [772mm]
Height - 1828mm
Weight - 145kg

Heated section - 2 Shelves = 0.06m³
Chilled section - 3 Shelves = 0.08m³

2.8 kw
complete with a 2m long cord set & 13amp plug

0.7mm 430 Grade St/Steel inner panels
1.2mm 304 Grade St/ Steel structure
1.2mm 430 Grade St Steel Ancillary Parts
6mm Tempered Glass
LED Illumination

Installation:
Mobile with all swivel castors two braked

ALL DIMENSIONS IN (mm), TOLERANCE = LINEAR $\pm 0.5\text{mm}$, ANGULAR $\pm 0.5\text{mm}$ (OR AS STATED). ALL SHARP EDGES TO BE REMOVED FROM SHEET METAL PARTS

Product	MERCANDISER				Product No	N/A		  The Catering Equipment Company			
Description	MHC1										
Material/Finish		Thickness		Desp/Date							
Legacy P/N		Weight	145kg	Quote No.		Dwg No.	GGP-042923		Issue		
Client					SO Number	N/A	Drawn By	ABB		-	
Client Project					Approved By		Date	19/07/2019			
E & R MOFFAT LTD, SEABEGS ROAD, BONNYBRIDGE, FK4 2BS, T: +44 (0)1324 812272, E: sales@ermoffat.co.uk, Web: www.ermoffat.co.uk							Scale	1 : 20	Sheet	1 / 2	A4